

Annexure

Registration / ನೋಂದಣಿ
(See Regulation 2.1.1(5))
(ನಿಬಂಧನ 2.1.1(5) ನ್ನು ನೋಡಿ)



Government of Karnataka
ಕರ್ನಾಟಕ ಸರ್ಕಾರ
Registration under FSS Act, 2006
ಎಫ್.ಎಸ್.ಎಸ್. ಕಾಯ್ದೆ, 2006 ರಡಿಯಲ್ಲಿ ನೋಂದಣಿ

Registration No.: 21219047000829

Food Items Details

Food Item	
1	16 - Prepared Foods
2	15 - Ready-to-eat savouries
3	14 - Beverages, excluding dairy products

Purvin
DESIGNATED OFFICER
Food Safety & Standard Act,
Stamp and Signature of the Designated Officer
Health & Family Welfare Dept
Chikkaballapur District



Office of the Regional Fire Officer, Bengaluru North Range,
Karnataka Fire & Emergency Services,
Thambandra Fire Station Premises, Manyata Embassy Business
Park, Nagawara Ring Road, Bengaluru-560 045.



No. 06: Educational : RFO : DNR : 2026

Date: 14-01-2026

To,
The Authorized signatory
Sri Adichunchanagiri Shikshana Trust(R)
BGS Institute of Management Studies
SJCIT Campus ,B.B road
Chikkaballapura-562101

Sub: Issue of "Fire safety recommendation" to "Sri Adichunchanagiri Shikshana Trust (R), BGS Institute of Management Studies" Educational building constructed at SJCIT Campus, B.B road ,Chikkaballapura-562101.

Ref: Your letter Dated 12-01-2026.

With reference to the subject cited above, the District Fire Officer, Chikkaballapura Fire Station has inspected the Educational Building "Sri Adichunchanagiri Shikshana Trust(R) BGS Institute of Management Studies" constructed at SJCIT Campus ,B.B road ,Chikkaballapura-562101 on 25-11-2025 with respect to fire prevention, fire fighting and evacuation measures to be complied in the above premises and submitted the details as follows:-

ANNEXURE-B
" Group-B Educational Building"

A. Details of the building / premises :-

01	Name and Address of the Applicant.	: The Authorized signatory Sri Adichunchanagiri Shikshana Trust(R) BGS Institute of Management Studies SJCIT Campus ,B.B road Chikkaballapura-562101
02	Name and Address of the premises.	: Sri Adichunchanagiri Shikshana Trust(R) BGS Institute of Management Studies SJCIT Campus ,B.B road Chikkaballapura-562101
03	Name and address of the Building owner	: The Authorized signatory Sri Adichunchanagiri Shikshana Trust(R) BGS Institute of Management Studies SJCIT Campus ,B.B road Chikkaballapura-562101
04	Number of buildings	: One building
05	Number of floors	: Ground & 3 upper floors.



03.	Width of entry / exit.	Entry/exits i.e. 1)02.90 Mtrs 2)04.30 Mtrs 3)02.10 Mtrs 4)02.10 Mtrs		
04.	Diesel generators.	Not provided		Diesel generator of 15 KVA capacity should be installed to supply alternate power to all the emergency provision of the building.
05.	No. of staircases available	Nos. of staircases	: 02 No's.	Complied
		Width of staircases	: 01.80 Mtrs. 01.80 Mtrs.	
		Width of treads	: 30 Cms. 28 Cms.	
		Height of risers	: 14 Cms. 15 Cms.	
		Nos. of riser per flight	: 11 No's 11 No's	
		Height of handrails	: 01.00 Mtr 01.00 Mtr	
		Head room clearance	: 02.60 Mtrs. 02.60 Mtrs.	
06.	No. lifts and capacity.	Nos. of lifts	: Not installed	
		Capacity of lifts	:	
07.	Fire extinguisher	The following extinguishers have been provided in the building: A) 16 nos. ABC powder type extinguishers, each of 6 kgs. capacity. B) 06 nos. CO2 extinguishers, each of 4.5 kgs capacity C) 05 no's of mechanical foam extinguisher of 9 ltrs capacity		Complied
08.	First aid hose reel hose.	Two hose reel hose systems at suitable place have been provided and the hose reel hose of min 19 mm size and adequate length of hose reel hose has been provided to reach the farthest point of each floors and shut off branch having a nozzle of 5mm size. the hose reel hose has been connected at each landing by means of an adaptor		Complied




09.	Terrace tank over respective tower terrace.	Provided one overhead tank of 20,000 litres capacity has been provided exclusively for fire fighting purpose.	Complied
10	At the terrace tank level with minimum pressure of 3.5 kg/cm ² .	Hose Reel Hose system have been connected a booster pump of 900 lpm capacity.	Complied
11	Escape routes	Directions in which the students have to move in the event of an emergency has been displayed with luminous paint near the entry & exit.	Complied
12	Fire siren	A fire siren has been installed in the premises to inform the inmates in case of a fire emergency an evacuate the area	Complied
13	No smoking board	Not displayed	COIPA Sec-4 direction "NO SMOKING" area-smoking here is an offence" board should be written in English & kannada both languages shall be prominently displayed at inside the entry / exit of the each floor.
14	Fire order	Not displayed	Fire safety plan for preventing and extinguishing accidental fire and details of actions to be taken in case of an emergency should be displayed in each floor with telephone numbers of Chikkaballapura Fire Station i.e. 08156277101 & fire control room 080-22971500,550,600 & 101/112 and telephone numbers of nearest ambulance services should be displayed near staircase landings at each floor of this building.
15	Fire nodal officer	Not nominated	A fire nodal officer shall be nominated either from teaching or non teaching staff.
16	Fire fighting training	Not imparted	At-least 40% of staff / employees should be trained in basic fire fighting course at our R.A.Mundkur Fire and Emergency Services Academy, Nannarghatta Road, Bangalore-29 at an earliest.



Floor-wise details of occupancy:-		
06	Ground floor	: 09-Labs, 02-Rooms & 02-Rest rooms
	1 st floor	: 04-Class rooms, 01-Office rooms, 02-labs, 05-exam section halls & 02-washrooms
	2 nd floor	: 09-Class rooms, 01-Exam section, 01-Staff room, 01-Office room, 01-Library, 01-Principal chamber & 02-Washroom
	3 rd floor	: 01-Staff room, 01-Sport room, 01-Computer lab, 01-Seminar hall, 11-Class rooms & 02-Washroom
07	Height of the building	: 14.78 Mtrs.
08	Site area	: 8122.00 Sq.Mtrs.
09	Built-up area of each floor:-	
	Ground floor	: 800.00 Sq.Mtrs.
	1 st floor	: 800.00 Sq.Mtrs.
	2 nd floor	: 800.00 Sq.Mtrs.
	3 rd floor	: 800.00 Sq.Mtrs.
10.	Total built-up area	: 3200.00 Sq.mtrs.
11.	Surrounding properties:-	
	West (Front)	: Property belongs to applicant
	East (Rear)	: Private property(KVT)
	North (Side)	: Private property
	South (side)	: 06.00 mtrs wide BGS Institute of Management Studies college road connected to 10.00 Mtrs. Bangalore-Chikkaballapura main road.
12.	Set-back area available around the building :-	
	West (Front)	: 05.00 Mtrs
	East (Rear)	: 04.00 Mtrs
	North (Side)	: 04.00 Mtrs
	South (side)	: 25.00 Mtrs

B. On inspection of this Educational premises, the following fire prevention, fire fighting and evacuation measures recommended are considered absolutely essential from fire safety point of view :-

Sl. No. (1)	Details (02)	Existing (03)	Recommendations (04)
01.	Accessibility to the premises	The premises is accessible from 10.00 mtrs wide BB road located on western side the roads hardened to carry the weight of 45,000kgs.	Adequate
02.	No. of entrances	Provided 4 Entry/Exits.	Adequate




Fire precautionary measures :-

- A) Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory etc.
- B) Accumulation of combustible waste in and the premises should be avoided.
- C) The exit ways shall be always kept clear without any obstruction.
- D) Liquefied petroleum gas should not be stores in the building.
- E) The doors shall not be kept locked / latched during working hours and shall be free from obstruction.
- F) During the class hours the class room doors shall not be locked from inside to out side.
- G) As per Honorable Supreme Court order all teachers and staffs shall be trained to handle safety equipment, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordinate Fire Service department.


As such the Karnataka State Fire and Emergency Services department is issuing 'Fire Safety Recommendation Certificate' to Educational Building "Sri Adalunchanagiri Shikshana Trust(R) BGS Institute of Management Studies" constructed at SJCT Campus .B.B road ,Chikkaballapura-562101 from Fire prevention, Fire fighting and Evacuation point of view subject to the compliance of recommendations mentioned above within 03 months from the date of issue of Fire Advisory Certificate.


Note:


1. This is only the "Fire Safety Recommendation Certificate" issued by the Fire Department from fire safety view of the low-rise already constructed Building. This shall not be considered as No Objection Certificate for the Building.
2. After completion of all the fire fighting installations as advised in Fire Advisory Certificate, 'Fire Recommendation Compliance Certificate' shall be obtained from the Fire and Emergency department.
3. This "Fire Safety Recommendation Certificate" is valid for a period of one year only from the date of issue.
4. Karnataka State Fire and Emergency Services department is not responsible for any dispute of land or building in the above said address.


Regional Fire Officer
Bangalore North Range
Manayata Tech Park,
Nagawara Ring Road, Bangalore-45,

Copy to: The District Fire Officer, Chikkaballapura Fire Station, Chikkaballapura.

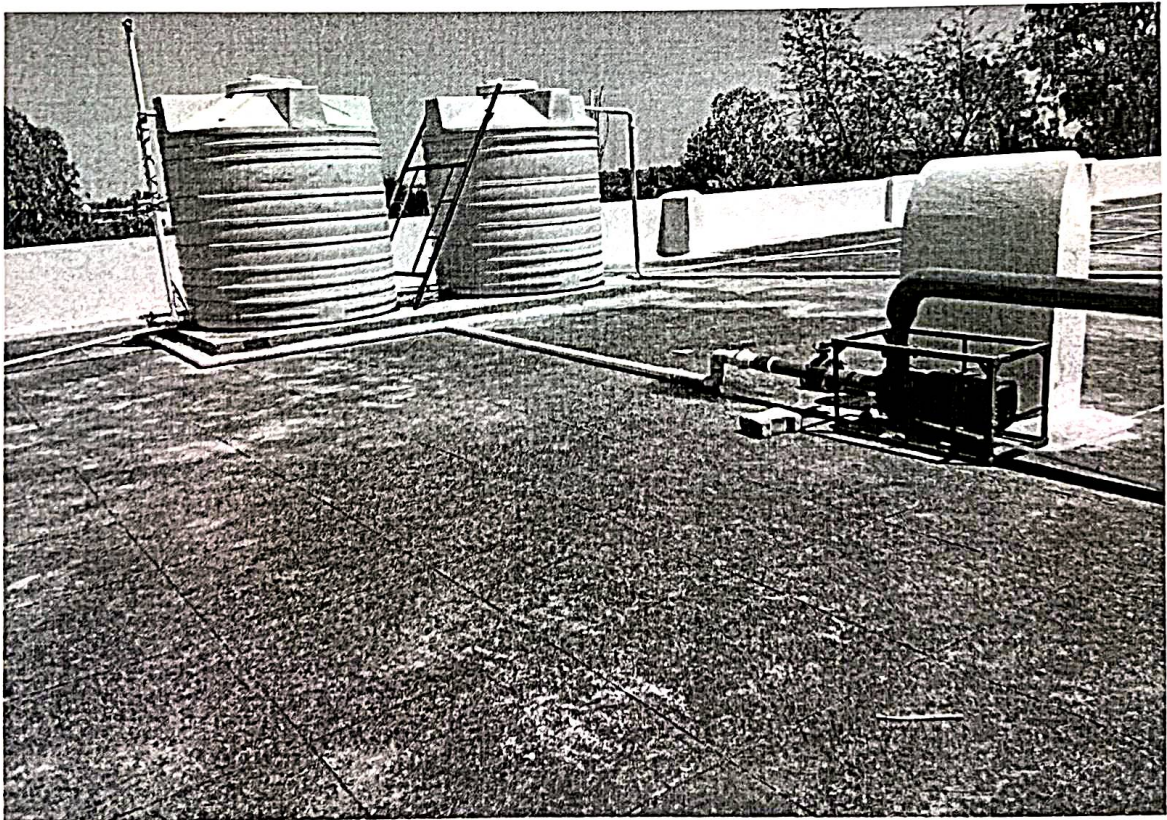

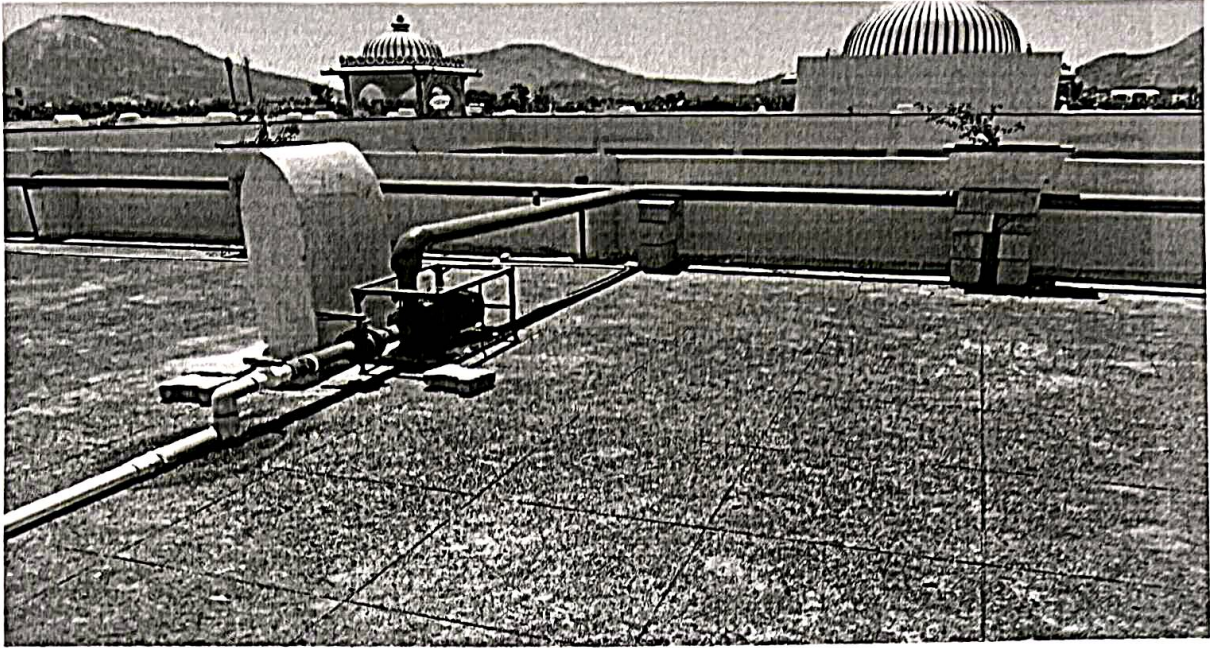


Principal
BGS Institute of Management Studies
BGS Campus (SJCT), B.B.Road,
Chickballapur-562101